

Hilti HAP 2.5 Elevator Hoist Anchor Point

Submission Folder

Product Information				
Technical Information				
Setting Instructions				
Letters				
Country of Origin	16			
Certification	17			
Job Reference				
HAP 1.15	18			
HAP 2.5	19			



HAP 2.5 ELEVATOR HOIST ANCHOR POINT





APPLICATIONS


Temporary suspension of elevator cabins or equipment during installation or maintenance work in elevator shafts

ADVANTAGES

- Pre-assembled delivered ready to install, optionally bundled with compatible anchors
- Built for one-person installation weighing under 3 kg, this hoist
- point is much faster and easier to install overhead

 Compatible with PROFIS Engineering software giving you a convenient method to design anchorage for the hoist anchor plate according to Eurocode 2 and ETAG
- Large, rigid hooking area hook point designed for easy engagement and to prevent swivelling loads

Technical data	
Anchor type	HST3 or HUS3
Material, corrosion	Cast-iron, Geomet coating
In-service temperature – range	-40 - 80 °C
Installation direction	Ceiling







	Sales pack quantity	Item number
Elevator hoist anchor point HAP 2.5	2 pc	2247638

Please visit Hilti website for the latest item numbers and related products



HAP 2.5 Hoist Anchor Plate

Hoist Anchor Plate with 2.5 t WLL capacity for elevator shaft operations

Anchor version

WLL 2.5t

Benefits

- 2.5 t WLL capacity according to Machinery Directive 2006/42/EC.
- Anchorage of hoist to be designed with PROFIS Anchor software for cracked and uncracked concrete, ≥ C20/25, according to EC2 and ETAG (No. 001 Annex C/2010).
- Recommended and designed for anchorage with anchors:
 - HST3 M12x115 (h_{nom}=80mm)
 - HUS3 H10x110 (h_{nom}=85mm)
- Delivered pre-assembled (one piece) with combo options available: HAP 2.5 + Anchors (4xHST3 or 4xHUS3).
- Lightweight: One person installation possible at overhead position total weight < 3Kg.
- No rotation of hook point allowed preventing swiveling.
- Large hooking area for easy engagement. Hook point: ø>90mm.
- Compact design for narrow spaces: rigid height < 56mm.
- Printed IFU on the product for immediate clarification.
- < 45° loading allowed in all directions.

WILL 2.51

HAP 2.5 + HUS3

HAP 2.5

HST3

Base material







Concrete (cracked)

Other information




PROFIS Anchor design Software

Applications

HAP 2.5 is designed to be used as post installed "master hoist point" for installation and/or maintenance in elevator shafts under static and quasi-static loading. In case of fatigue loading see TWU72/18. It can be used with manual or motor hoists and bears a working load up to 2.5 tons in variable directions.



Warning

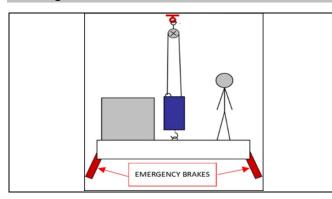

Men riding (Car-top Lift-installation Method) (worker and material on top of the cabin)


In case the main hoist point fails, the platform falls ~0.3m until the elevator safety-gears will automatically activate bringing the elevator cabin to a complete stop. Emergency brakes need to be activated.

Basic loading data

Data for max 2.5 t WLL capacity applies to HAP 2.5 only when:

- Correct design of anchorage (see "design of anchorage")
- Installation and anchor setting according to IFU from HAP 2.5t and corresponding anchor (HUS3 or HST3)
- No shock loading; vibratory dynamic safety factor γ_{dyn} up to 1.8

HAP Working Load Limitation (WLL)a)b)

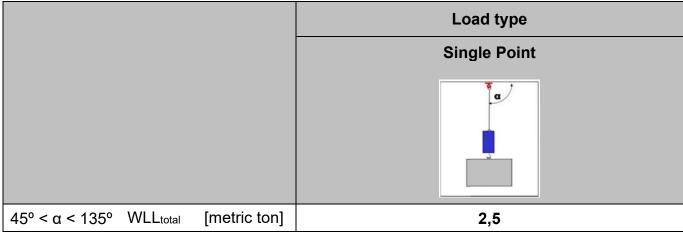

- a) In accordance with machinery safety directive 2006/42/EC the following working coefficients were implemented:
- Working coefficient of all metal components: γ = 4
- Working coefficient of the cables: γ = 5
- b) Data valid (including hoist and anchors) for static loading and fatigue cycling loading and a number of cycles NcyclesK < 1000 under pure tension or up to a load inclination of 45°, see test report TWU72/18.

Data valid (hoist only) for static loading and fatigue cycling loading and a number of cycles 1000 < NcyclesK < 10000 under pure tension or up to a load inclination of 45°. Anchors must be verified separately. For further details please contact you Hilti account manager and see test report TWU72/18.


Materials


Material quality

Part	Material / Mechanical properties or standard	
Carrier plate	Rm 700-900 Mpa – 5 µm Geomet 321A	
Wire rope φ11x150 – 6x36WS IWRC	Rope: steel 1960 MPa, zinc plated / ferrule: Alu	
Holder	Low carbon steel – 5 µm Geomet 321A	
Blind rivet DIN EN ISO 15977 – 6.4x18	Stainless steel	



Dimensions



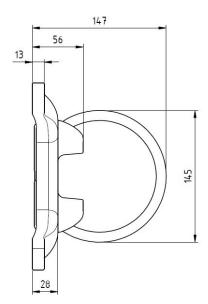

Onsite qualification

HAP 2.5 is designed for temporary & permanent application under dry indoor conditions.

Recommended tools to do onsite qualification: Anchor Tester HAT 28-E (#386372) with HAT Kit HAP 2.5 (#2301103).

Installation instructions

1) Install the anchors according to the Hilti Instruction for use. Only HST3 M12 with hnom ≥ 80mm and HUS3 H10 with hnom ≥ 85mm are qualified. Make sure HAP 2.5 is correctly installed, according to the Instruction for use of the HAP 2.5. Set up the HAT 28E according to the manual provided with the anchors tester. Set bridge legs to right heights. (Image 1). Then, connect the ring bolt adapter to steel wire rope. Always use the provide steel disc as shown in Image 2. Not using it could result in unallowed bending of the wire. Thus damaging the HAP 2.5. A HAP 2.5 with a bent wire is not safe for use.





Image 1

Image 2

2) Connect HAT 28-E with ring bolt adapter and make sure the bridge of the tester is parallel to the concrete surface as well as to the HAP 2.5 base (*Image 3*). Check if the baseplate can be moved versus the concrete. It needs to be firm. Turn crank in clockwise direction until legs in contact with base material bring the sytem to a still situation (without starting the loading process). Check and make sure pullout force acts parallel to axis of anchors and to the legs of tester. HAP 2.5 must remain centered in the both parallel and perpendicular direction of the tester.





Image 3



3) Set the red handle of the analogue gauge to zero in order to be able to start the measurement. (Image 4).



Image 4

4) Hold the HAT 28-E by the grip while increasing the load of the HAP 2.5 by turning the crank (or with spanner wrench on hexagon nut on top of tester) in a clockwise direction. Increase the load until desired proof load is attained. *Image 5*. Do not exceed the maximum allowable load of the tester of 30kN!



Image 5

5) Keep the proof load on HAP 2.5 for the desired time. Do not keep retightening if the loading relaxes during this time. The displacement is not allowed to increase in this time.



6) (Image 6)

Release the load by turning the crank counterclockwise



Image 6

- 7) Remove HAT 28-E and ring bolt adapter.
- 8) Perform visual check on HAP 2.5 and base material (*Image 7*).

Check if the baseplate is still firmly pressed to the concrete. If baseplate is lose, re-tight anchors and repeat procedure from the beginning.

We recommend **NOT TO USE** the tested HAP 2.5 when:

- The baseplate is lose also after repeated test.
- If the basematerial shows cracks during and or after the test around the HAP 2.5. It could be the sign of an overload of the concrete.
- If the HAP is damaged or deformed or the cable is bent.



Image 7



In these cases set a new point in a different position and repeat procedure from the beginning.

9) If the testing was successful mark or label the HAP 2.5 according to your requirements.

Design of anchorage

An exemplary calculation under static considerations of a Hoist with different Hilti anchoring products designed with Hilti Profis engineering can be found below while the Input data applies. In case of different design conditions a new clalculation should be performed.

HAP 2.5 is designed to be used as hoist point for lifting loads under variable directions in elevator installation or maintenance. The design of an anchorage for the HAP 2.5 must be ensured for varying load conditions (varying directions, dynamic effects, etc.). For this the anchorage for HAP 2.5 has to be designed according to extreme load cases: a concrete anchor can only be considered as suitable for use with the HAP 2.5 hoist point if the approved anchor satisfies the following load scenarios (e.g. by PROFIS calculation) with EC2-4 calculation method. It has to be done in accordance with the relevant codes/ETAs for each application case separately.

HAP 2.5 t + HST3 M12 - Pure tension

N= Action = 2,5t (WLL) x 1,8 (γ_{dyn}) = 45 kN



1 Input data

Anchor type and size: HST3 M12 hef2

Item number: 2105719 HST3 M12x115 40/20 Effective embedment depth: $h_{ef} = 70.0 \text{ mm}, h_{nom} = 80.0 \text{ mm}$

Material:

Approval No.: ETA-98/0001
Issued I Valid: 09/02/2018 | -

Proof: Design Method ETAG (No. 001 Annex C/2010)

Stand-off installation: $e_h = 0.0 \text{ mm}$ (no stand-off); t = 11.0 mm

Baseplate R: $I_x \times I_y \times t = 220.0 \text{ mm} \times 220.0 \text{ mm} \times 11.0 \text{ mm}$; (Recommended plate thickness: not calculated)

Profile: Cylinder, 10; $(L \times W \times T) = 10.0 \text{ mm} \times 10.0 \text{ mm}$

Base material: cracked concrete, C20/25, $f_{c,cube} = 25.00 \text{ N/mm}^2$; h = 150.0 mm


Installation: hammer drilled hole, Installation condition: Dry

Reinforcement: No reinforcement or Reinforcement spacing >= 150 mm (any \emptyset) or >= 100 mm (\emptyset <= 10 mm)

no longitudinal edge reinforcement

Reinforcement to control splitting according to ETAG 001, Annex C, 5.2.2.6 present.

Geometry [mm] & Loading [kN, kNm]

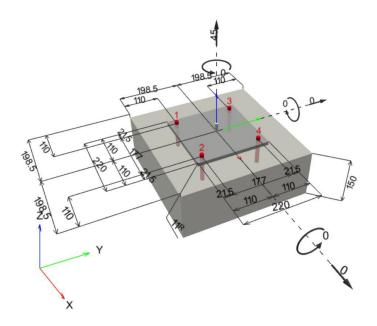



 $^{^{\}mbox{\scriptsize R}}$ - The anchor calculation is based on a rigid baseplate assumption.



1.1 Load combination

Case	Description	Forces [kN] / Moments [kNm]	Seismic	Fire	Max. Util. Anchor [%]
1	Combination 1	$N = 45.000; V_x = 0.000; V_y = 0.000;$	no	no	95
		$M_{\rm h} = 0.000$; $M_{\rm h} = 0.000$; $M_{\rm h} = 0.000$;			

2 Load case/Resulting anchor forces

Load case: Design loads


Anchor reactions [kN]

Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	11.250	0.000	0.000	0.000
2	11.250	0.000	0.000	0.000
3	11.250	0.000	0.000	0.000
4	11.250	0.000	0.000	0.000

max. concrete compressive strain: - [‰] max. concrete compressive stress: - [N/mm²] resulting tension force in (x/y)=(0.0/0.0):

Tension \bigcirc 1 45.000 [kN] resulting compression force in (x/y)=(0.0/0.0): 0.000 [kN]



HAP 2.5 t + HST3 M12 - 45° angle

 $N = N_t \times sen45^\circ = 32kN$ $Vx = N_t x \cos 45^\circ = 32kN$

1 Input data

Anchor type and size: HST3 M12 hef2

Item number: 2105719 HST3 M12x115 40/20 Effective embedment depth: h_{ef} = 70.0 mm, h_{nom} = 80.0 mm

Anchor forces are calculated based on the assumption of a rigid baseplate.

Material:

ETA-98/0001 Approval No.: Issued I Valid: 09/02/2018 | -

Proof: Design Method ETAG (No. 001 Annex C/2010)

Stand-off installation: $e_b = 0.0 \text{ mm}$ (no stand-off); t = 11.0 mm

 $I_x \times I_y \times t = 220.0 \text{ mm} \times 220.0 \text{ mm} \times 11.0 \text{ mm}$; (Recommended plate thickness: not calculated) Baseplate^R:

Profile: Cylinder, 10; (L x W x T) = 10.0 mm x 10.0 mm

Base material: cracked concrete, C20/25, $f_{c,cube} = 25.00 \text{ N/mm}^2$; h = 150.0 mm

hammer drilled hole, Installation condition: Dry Installation:

No reinforcement or Reinforcement spacing >= 150 mm (any \emptyset) or >= 100 mm (\emptyset <= 10 mm) Reinforcement:

no longitudinal edge reinforcement


Reinforcement to control splitting according to ETAG 001, Annex C, 5.2.2.6 present.



^R - The anchor calculation is based on a rigid baseplate assumption.



Geometry [mm] & Loading [kN, kNm]

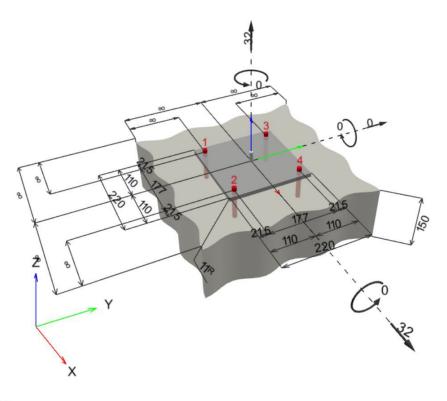

1.1 Load combination

	Case	Description	Forces [kN] / Moments [kNm] Seismic		Fire	Max. Util. Anchor [%]	
-	1	Combination 1	$N = 32.000; V_x = 32.000; V_y = 0.000;$	no	no	70	
			$M_{\odot} = 0.000$; $M_{\odot} = 0.000$; $M_{\odot} = 0.000$;				

2 Load case/Resulting anchor forces

Load case: Design loads

Anchor reactions [kN]

Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	8.000	8.000	8.000	0.000
2	8.000	8.000	8.000	0.000
3	8.000	8.000	8.000	0.000
4	8.000	8.000	8.000	0.000

 $\label{eq:max_concrete} \begin{array}{ll} \text{max. concrete compressive strain:} & \text{- [‰]} \\ \text{max. concrete compressive stress:} & \text{- [N/mm}^2] \\ \text{resulting tension force in (x/y)=(0.0/0.0):} & 32.000 \text{ [kN]} \\ \text{resulting compression force in (x/y)=(0.0/0.0):} & 0.000 \text{ [kN]} \\ \end{array}$

Anchor forces are calculated based on the assumption of a rigid baseplate.

HAP 2.5 t + HUS3 H10 - Pure tension

N= Action = 2,5t (WLL) x 1,8 (γ_{dyn}) = 45 kN



1 Input data

Anchor type and size: HUS3-H 10 h_nom3

 Material:
 1.5525

 Approval No.:
 ETA-13/1038

 Issued I Valid:
 27/04/2018 |

Proof: Design Method ETAG (No. 001 Annex C/2010)

Stand-off installation: $e_b = 0.0 \text{ mm}$ (no stand-off); t = 11.0 mm

Baseplate R: $I_x \times I_y \times t = 220.0 \text{ mm} \times 220.0 \text{ mm} \times 11.0 \text{ mm}$; (Recommended plate thickness: not calculated)

Profile: Cylinder, 10; (L x W x T) = 10.0 mm x 10.0 mm

Base material: cracked concrete, C20/25, $f_{c,cube} = 25.00 \text{ N/mm}^2$; h = 150.0 mm


Installation: hammer drilled hole, Installation condition: Dry

Reinforcement: No reinforcement or Reinforcement spacing >= 150 mm (any Ø) or >= 100 mm (Ø <= 10 mm)

no longitudinal edge reinforcement

Reinforcement to control splitting according to ETAG 001, Annex C, 5.2.2.6 present.

Geometry [mm] & Loading [kN, kNm]

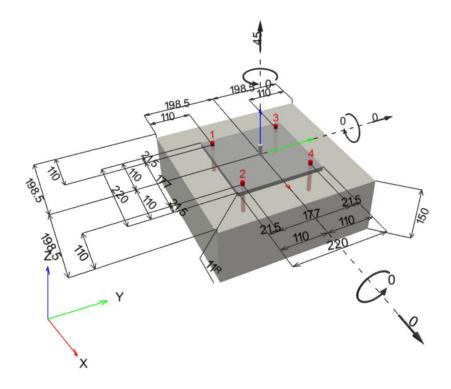

 $^{^{\}mbox{\scriptsize R}}$ - The anchor calculation is based on a rigid baseplate assumption.



1.1 Load combination

Case	Description	Forces [kN] / Moments [kNm]	Seismic	Fire	Max. Util. Anchor [%]
1	Combination 1	$N = 45.000; V_x = 0.000; V_y = 0.000;$	no	no	97
		$M_{\rm h} = 0.000$; $M_{\rm h} = 0.000$; $M_{\rm h} = 0.000$;			

2 Load case/Resulting anchor forces

Load case: Design loads


Anchor reactions [kN]

Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	11.250	0.000	0.000	0.000
2	11.250	0.000	0.000	0.000
3	11.250	0.000	0.000	0.000
4	11.250	0.000	0.000	0.000

 $\begin{array}{lll} \text{max. concrete compressive strain:} & \text{- } [\%] \\ \text{max. concrete compressive stress:} & \text{- } [\text{N/mm}^2] \\ \text{resulting tension force in (x/y)=(0.0/0.0):} & 45.000 \text{ [kN]} \\ \text{resulting compression force in (x/y)=(0.0/0.0):} & 0.000 \text{ [kN]} \\ \end{array}$

Anchor forces are calculated based on the assumption of a rigid baseplate.



HAP 2.5 t + HUS3 H10 - 45° angle

 $N = N_t x sen45^\circ = 32kN$ $Vx = N_t x cos45^\circ = 32kN$

1 Input data

Anchor type and size: HUS3-H 10 h_nom2

 Material:
 1.5525

 Approval No.:
 ETA-13/1038

 Issued I Valid:
 27/04/2018 |

Proof: Design Method ETAG (No. 001 Annex C/2010) Stand-off installation: $e_b = 0.0 \text{ mm}$ (no stand-off); t = 11.0 mm

Baseplate^R: $I_x \times I_y \times t = 220.0 \text{ mm} \times 220.0 \text{ mm} \times 11.0 \text{ mm}$; (Recommended plate thickness: not calculated)

Profile: Cylinder, 10; (L x W x T) = 10.0 mm x 10.0 mm

Base material: cracked concrete, C20/25, f_{c,cube} = 25.00 N/mm²; h = 150.0 mm

Installation: hammer drilled hole, Installation condition: Dry

Reinforcement: No reinforcement or Reinforcement spacing >= 150 mm (any \emptyset) or >= 100 mm (\emptyset <= 10 mm)

no longitudinal edge reinforcement


Reinforcement to control splitting according to ETAG 001, Annex C, 5.2.2.6 present.



^R - The anchor calculation is based on a rigid baseplate assumption.



Geometry [mm] & Loading [kN, kNm]

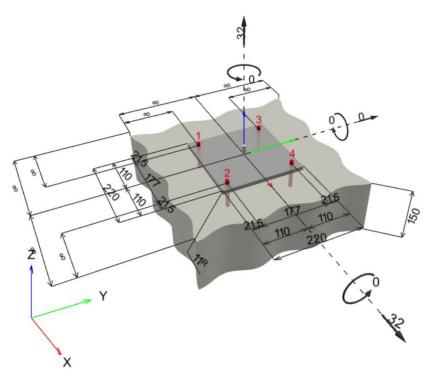

1.1 Load combination

Case	Description	Forces [kN] / Moments [kNm]	Seismic	Fire	Max. Util. Anchor [%]
1	Combination 1	$N = 32.000; V_x = 32.000; V_y = 0.000;$	no	no	100
		$M = 0.000 \cdot M = 0.000 \cdot M = 0.000 \cdot$			

2 Load case/Resulting anchor forces

Load case: Design loads

Anchor reactions [kN]


Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	8.000	8.000	8.000	0.000
2	8.000	8.000	8.000	0.000
3	8.000	8.000	8.000	0.000
4	8.000	8.000	8.000	0.000

max. concrete compressive strain: - [‰] max. concrete compressive stress: - [N/mm²] resulting tension force in (x/y)=(0.0/0.0):

32.000 [kN] resulting compression force in (x/y)=(0.0/0.0): 0.000 [kN]

Anchor forces are calculated based on the assumption of a rigid baseplate.






Setting information

Setting parameters

Parameter			HAP 2.5
Minimum base material thickness	h_{min}	[mm]	According to technical data of applied anchors
Spacing (Hoist Anchor Plate)	s	[mm]	178
Edge distance	С	[mm]	According to technical data of applied anchors ^{a)}

a) For smaller edge distances the design loads have to be reduced (see ETAG 001, Annex C).



Inspection criteria

Caution: The attachment point must be in a good operating condition and undamaged. Broken wires, signs of corrosion, visible distortions or deformations are unacceptable.


Caution: The shaft ceiling, particularly the concrete, must be in sound condition. Any visible cracking, blow out or signs of corrosion are unacceptable.

Caution: Do not use an attachment point which has an unreadable or missing identification label.








2260439 A1-10.2019


































TYPE-EXAMINATION CERTIFICATE

Issued by Liftinstituut B.V.

Certificate no. : NL22-400-1002-429-01 Revision no.: -

Description of the product : Hoist anchor plate

Trademark : Hilti

Type no. : HAP 2.5

Name and address of the

manufacturer

: Hilti

Feldkircherstrasse 100

9494 Schaan Liechtenstein

Name and address of the

certificate holder

: Hilti

Feldkircherstrasse 100

9494 Schaan Liechtenstein

Certificate issued on the following requirements

Certificate based on the

following standard

: Parts of: EN 1677-1:2001+A1:2008

Test laboratory : None

Date and number of the

laboratory report

: None

Date of type examination : September 2020-July 2022

Additional document with this

certificate

: Report belonging to the type examination certificate

no.: NL22-400-1002-429-01

Additional remarks : None

Conclusion : This product meets the requirements of the relevant paragraphs

of EN 1677-1:2001+A1:2008 taking into account any additional

remarks mentioned above.

Amsterdam

Date : 18-07-2022 Valid until : 18-07-2027 ing A.J. van Ommen International Business

Manager

Certification decision by



Attn. : To whom it may concern

Date : 26 September 2023 Ref. : 081/FP/DY/23

Subject : Country of Origin- Hilti HAP 2.5 Elevator Hoist Anchor Point

Dear Sir / Madam,

Enclosed please find the information of Hilti HAP 2.5 Elevator Hoist Anchor Point

Brand Name : Hilti

Model Name : Hilti HAP 2.5 Elevator Hoist Anchor Point

Manufacturer : Hilti Corporation

Address of Manufacturer: FL-9494, Principality of Liechtenstein.

Manufacturer Contact Person : Dennis Yeung

Supplier : Hilti (Hong Kong) Ltd

Address of Supplier : 701-704, 7/F, Tower A, Manulife Financial Centre,

223 Wai Yip Street, Kwun Tong, Kowloon, Hong Kong

Supplier Contact Person : Dennis Yeung (+852 9723 4621)

Country of Origin : China

Should you have further questions, please do not hesitate to contact our Technical Representatives, Customer Service Hotline at 8228-8118, or email us at hksales@hilti.com.

Yours faithfully,

MKTO WKTO

Dennis Yeung Head of Product Leadership Strategy, F&P

Hilti (Hong Kong) Ltd.

701-704 | Tower A | Manulife Financial Centre 223 Wai Yip Street | Kwun Tong Kowloon | Hong Kong

P +852-8228 8118 | **F** +852-2954 1751

www.hilti.com.hk



Hilti HAP 2.5 Elevator Hoist Anchor Point Job Reference

Year	Project Name	Customer Name	Project type
2023	N LANTAU HOSPITAL PH2 STAGE 1 - HOSPITAL AUT	DRAGAGES HONG KONG LIMITED	Industrial
2023	R6 TRUNK ROAD T2 ED/2018/04	BOUYGUES TRAVAUX PUBLICS	Infrastructure
2023	R6 CTL KLN ROUTE-BUILDING AND E&M HY/2019/13	GAMMON CONSTRUCTION LIMITED	Infrastructure
2024	R6 CTL KLN ROUTE-KAI TAK WEST HY/2014/07	GAMMON CONSTRUCTION LIMITED	Infrastructure
2024	R6 CTL KLN ROUTE-BUILDING AND E&M HY/2019/13	GAMMON CONSTRUCTION LIMITED	Infrastructure
2024	WEST KOWLOON - LYRIC THEATRE - (IPS)	OTIS ELEVATOR COMPANY	Community & Cultural
2024	HO MAN TIN STATION RES PACKAGE 1	GAMMON CONSTRUCTION LIMITED	Residential
2024	FORMER EXCELSIOR REDEVELOP - PROJECT BLUE	GAMMON ENGINEERING & CONSTRUCTION	Office